


NOTES:

1. The cabinet shall be provided with a concrete paving flag (900mm x 60mm x50mm) in front of each cabinet access door.
2. The cabinet shall be incased with a concrete (GRADE C10P) surround. The surround shall be 200mm bigger than the "footprint" of the cabinet in all directions and 300mm thick.
3. Controllors mounted on a root based plinth shall be sealed at base level. Following the termination of all cables the *contractor* shall backfill the controller void with dry compacted sand. This shall be sealed by a 6mm thick epoxy resin to form a water and airtight seal
4. Have a hazard warning label "DANGER 240v" 75mm x 115mm afixed to each door of the cabinet.
5. The cabinet shall have a thin coating of graphite grease applied to all moving parts (hinges and locks etc)
6. All dimensions are in millimetres unless stated otherwise

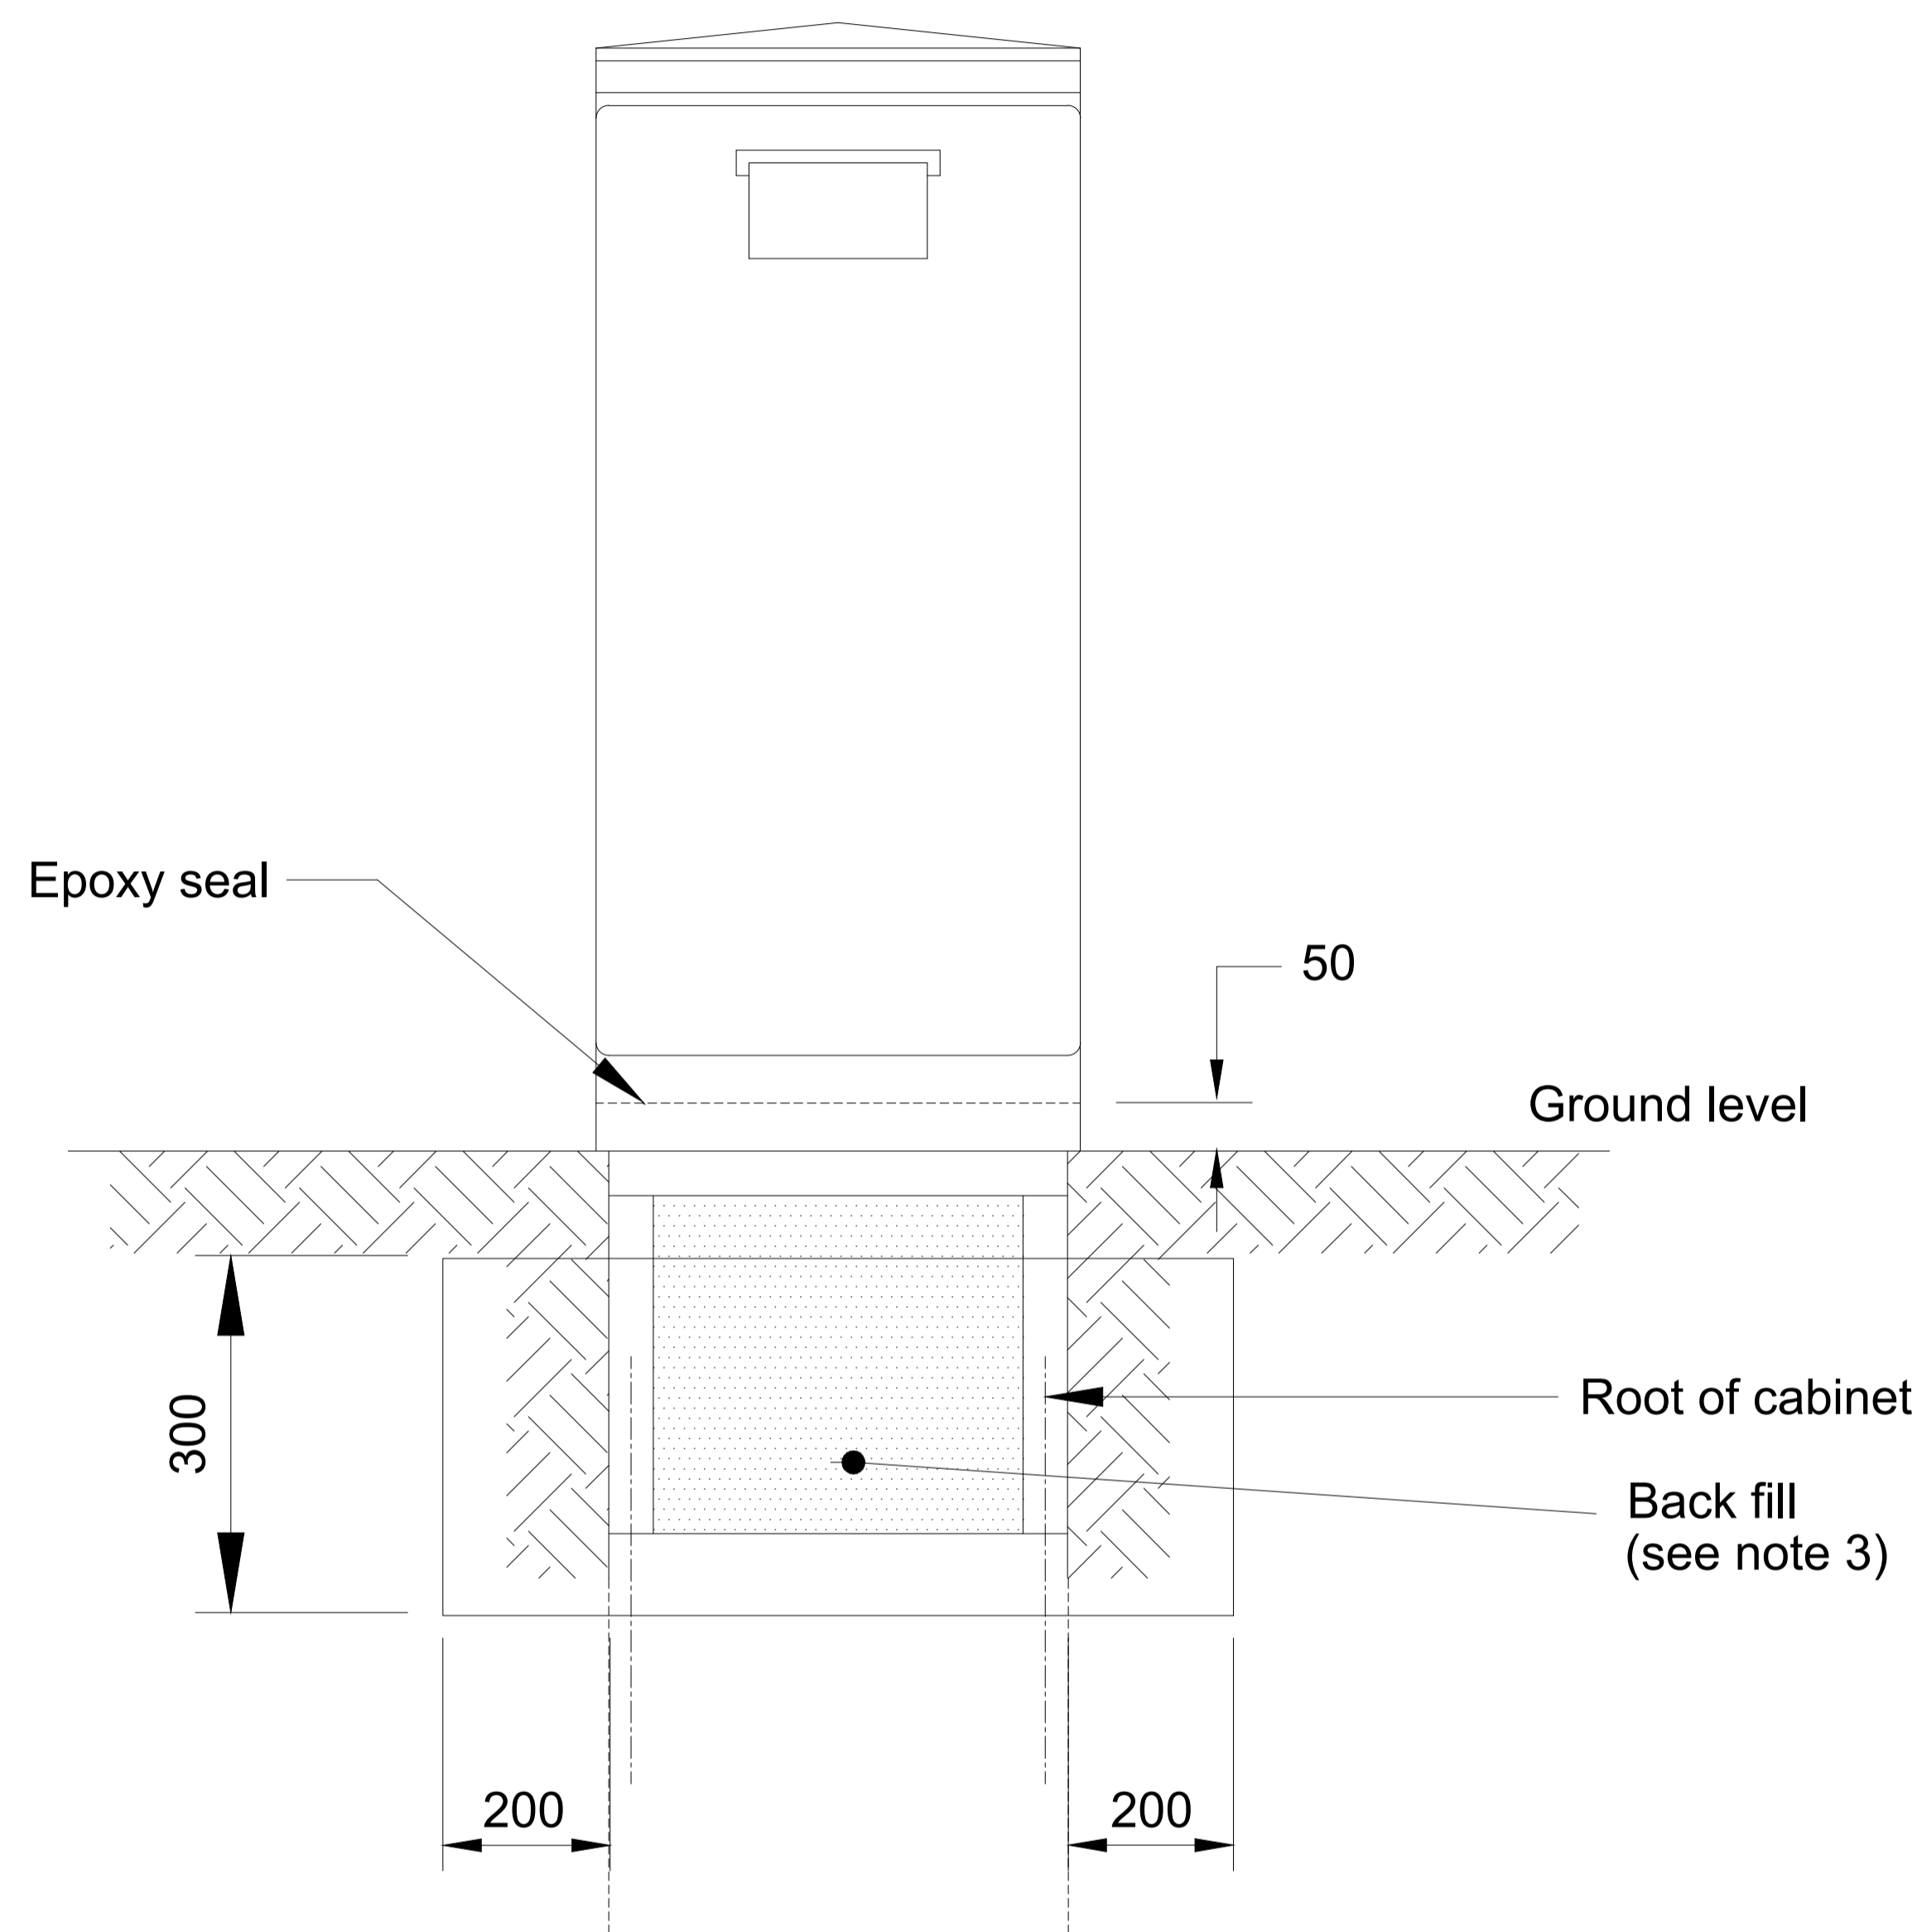

Notes

Description	Dwn	Chk	App	Date
- Various drawing revisions	-	-	-	-

IWP No.	N/A			
	CAD	Drawn	Checked	Approved
Initials	GW	GW	AJM	CJG
Date	07/11	07/11	07/11	07/11
Sht No.	1 OF 1			
Scales	NTS			

Drg. No.	HST-1200-502	Rev.	-
Project Title	HCC STANDARD DETAIL DRAWINGS		
Drawing Title	CONTROLLER CABINET FOUNDATION DETAILS		

COUNTY HALL
Pegs Lane
Hertford, Herts
SG13 8DN
Phone: 01992 555555