


NOTES:-

1. Sizes of incoming a cables re stated on schematic cable layout diagrams.
2. Padlock and key requirements are stated in Appendix 14/4.

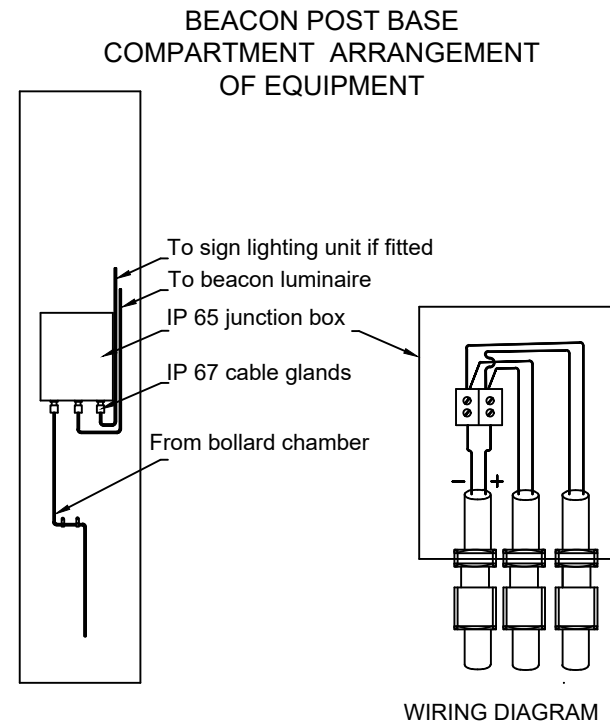

Notes

	IWP No.	Drg. No.	HST-1400-013		Rev.	-
			Project Title			
			HCC STANDARD DETAIL DRAWINGS			
			Drawing Title			
			TERMINATION DETAIL 2W AND 24 V SUB			
			Sht No.			
			1 OF 1			
			Scales			
			NTS			

Hertfordshire

COUNTY HALL
Pegs Lane
Hertford, Herts
SG13 8DN
Phone: 01992 555555