At Original Drawing Size This Line Measures 100mm

Original Drawing Size A3

Computer File No.

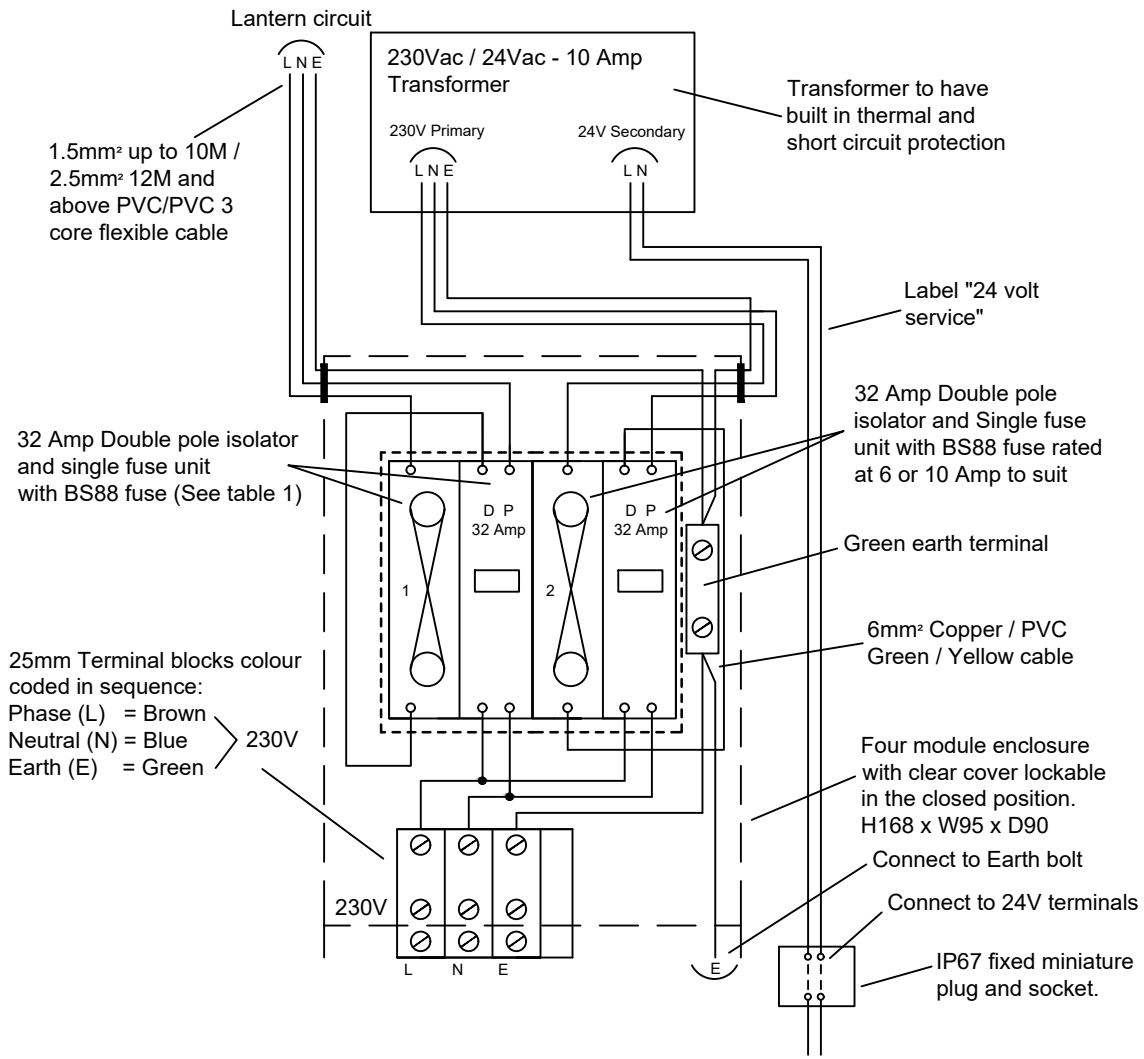

NOTES:

1. All dimensions in millimeters unless otherwise stated.
2. All isolation units shall comply with H.S.E. Electricity At Work Regulations 1989, BS 7671 and I.L.P. Code of Practice.
3. Double pole isolating switches shall comply with BS 60947-3.
4. A label to BS 951 with the words "Safety Electrical Connection - Do Not Remove" shall be permanently fixed at the earth terminal.
5. A label with the words "Warning Contains 24 volt and 230 vo Voltages" shall be permanently fixed on the front on the enclosure. 24 volt transformers shall be Class II insulated complete with fixing points.
6. Each isolator shall prevent unauthorized interference via a padlock; without the need of additional accessories and shall be clearly marked so as to show which equipment it relates to.
7. The position of the contactors or other means of isolation shall be either externally visible or clearly and reliably marked.
8. All equipment to be labelled clearly and visibly and isolation point Sign affixed to column as per standard detail drawing HST/1400/13

Notes

IWP No.				
	CAD	Drawn	Checked	Approved
Initials	PB	PB	ADS	FPL
Date	7/11	7/11	7/11	7/11
Sht No.	1 OF 1			
Scales	NTS			

Drg. No. HST-1400-014

Rev. –

Project Title: HCC STANDARD DETAIL DRAWINGS

Drawing Title: 24VOLT SUB SERVICE (INTERNAL)

Hertfordshire
COUNTY HALL
Pegs Lane
Hertford, Herts
SG13 8DN
Phone: 01992 555555

This Drawing is the copyright of Hertfordshire County Council and Must Not be Reproduced Without Written Permission