


NOTES:

1. IP 55 enclosure for group switching panel layout and wiring see Drg.No. HST/1400/020.
 2. All cables shall be neatly installed and be either tie rapped or fixed to the back board.
 3. Cable reduction box (if specified by the engineer) shall be an IP55 plastic enclosure containing terminal block as specified by the engineer. the box shall be connected to the group switching panel via box couplers (IP55).
- * Socket only required if specified / agreed by the Overseeing Organisation.

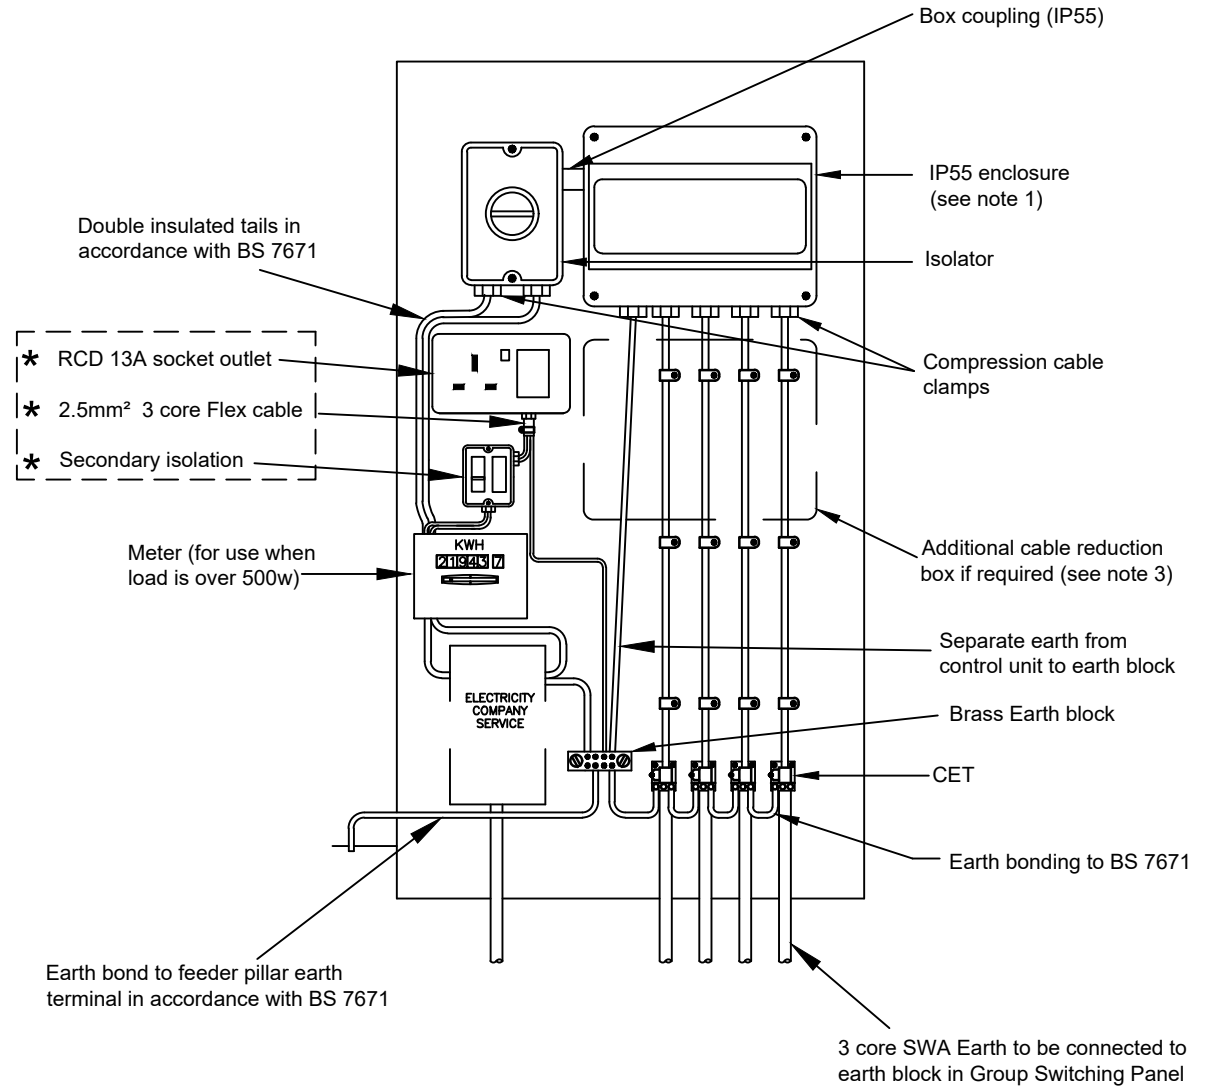

Notes

IWP No.					Drg. No.			Rev.																
					HST-1400-019			—																
<table border="1"> <tr> <td></td> <td>CAD</td> <td>Drawn</td> <td>Checked</td> <td>Approved</td> </tr> <tr> <td>Initials</td> <td>PB</td> <td>PB</td> <td>ADS</td> <td>FPL</td> </tr> <tr> <td>Date</td> <td>7/11</td> <td>7/11</td> <td>7/11</td> <td>7/11</td> </tr> </table>						CAD	Drawn	Checked	Approved	Initials	PB	PB	ADS	FPL	Date	7/11	7/11	7/11	7/11	Project Title				
	CAD	Drawn	Checked	Approved																				
Initials	PB	PB	ADS	FPL																				
Date	7/11	7/11	7/11	7/11																				
					HCC STANDARD DETAIL DRAWINGS																			
Sht No.					Drawing Title																			
1 OF 1					SINGLE PHASE GROUP SWITCHING PANEL PILLAR LAYOUT																			
Scales																								
NTS																								


 COUNTY HALL
 Pegs Lane
 Hertford, Herts
 SG13 8DN
 Phone: 01992 555555