

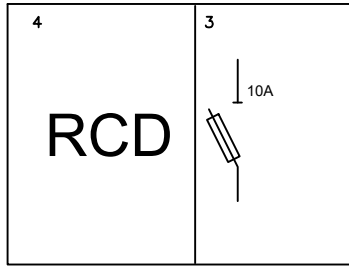


NOTES:

1. Rotary isolator (switch disconnecter)
2. Neon Indicator (Red)
3. BS88 fuse carrier - for fuse ratings see contract documents
4. 30 mA RCD

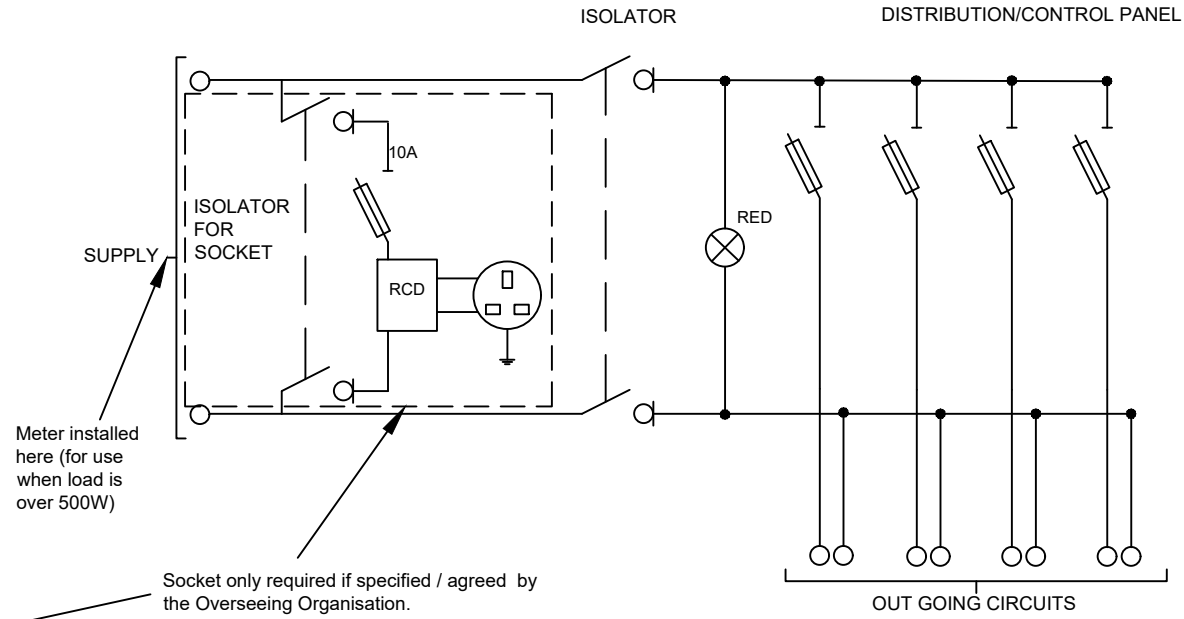

RCD AND SOCKET

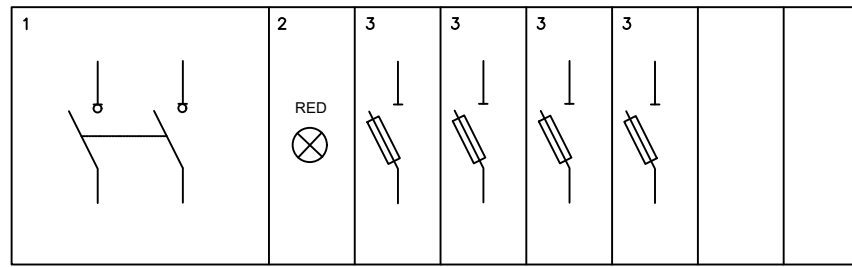

GROUP SWITCHING PANEL

Notes

IWP No.				Drg. No.				Rev.	
				HST-1400-020				-	
Initiate				Project Title					
PB PB ADS FPL				HCC STANDARD DETAIL DRAWINGS					
Date				Drawing Title					
7/11 7/11 7/11 7/11				SINGLE PHASE GROUP SWITCHING PANEL CIRCUIT DIAGRAM AND COMPONENT LAYOUT					
Sht No.									
1 OF 1									
Scales									
NTS									

COUNTY HALL
 Pegs Lane
 Hertford, Herts
 SG13 8DN
 Phone: 01992 555555